


ELEVATION VIEW
200AMP METER BASE

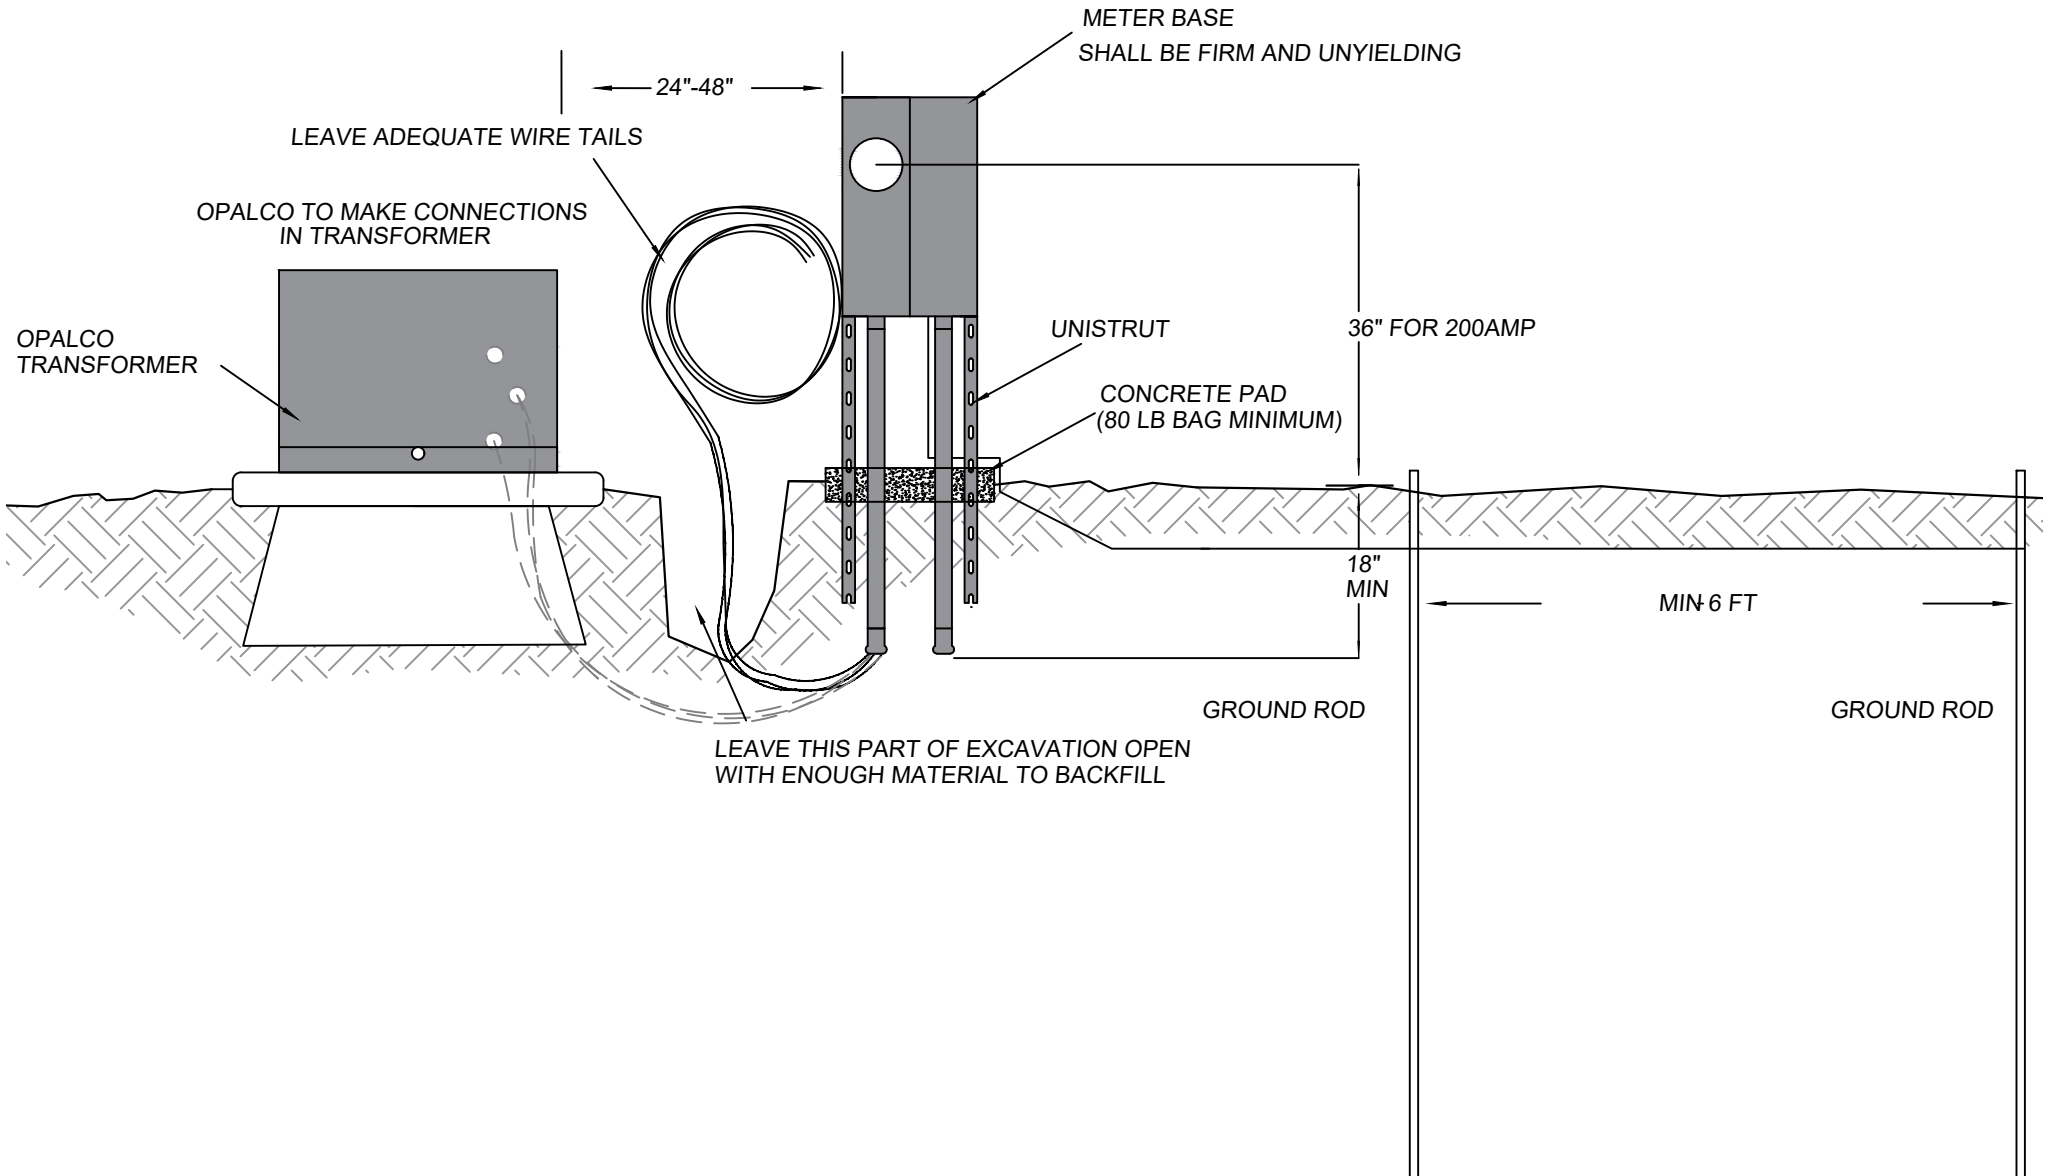

METER BASE
SHALL BE FIRM AND UNYIELDING

24"-48"

LEAVE ADEQUATE WIRE TAILS

OPALCO TO MAKE CONNECTIONS
IN TRANSFORMER

OPALCO
TRANSFORMER

UNISTRUT

36" FOR 200AMP

CONCRETE PAD
(80 LB BAG MINIMUM)

18"
MIN

MIN 6 FT

GROUND ROD

GROUND ROD

LEAVE THIS PART OF EXCAVATION OPEN
WITH ENOUGH MATERIAL TO BACKFILL