


ELEVATION VIEW
200AMP METER BASE

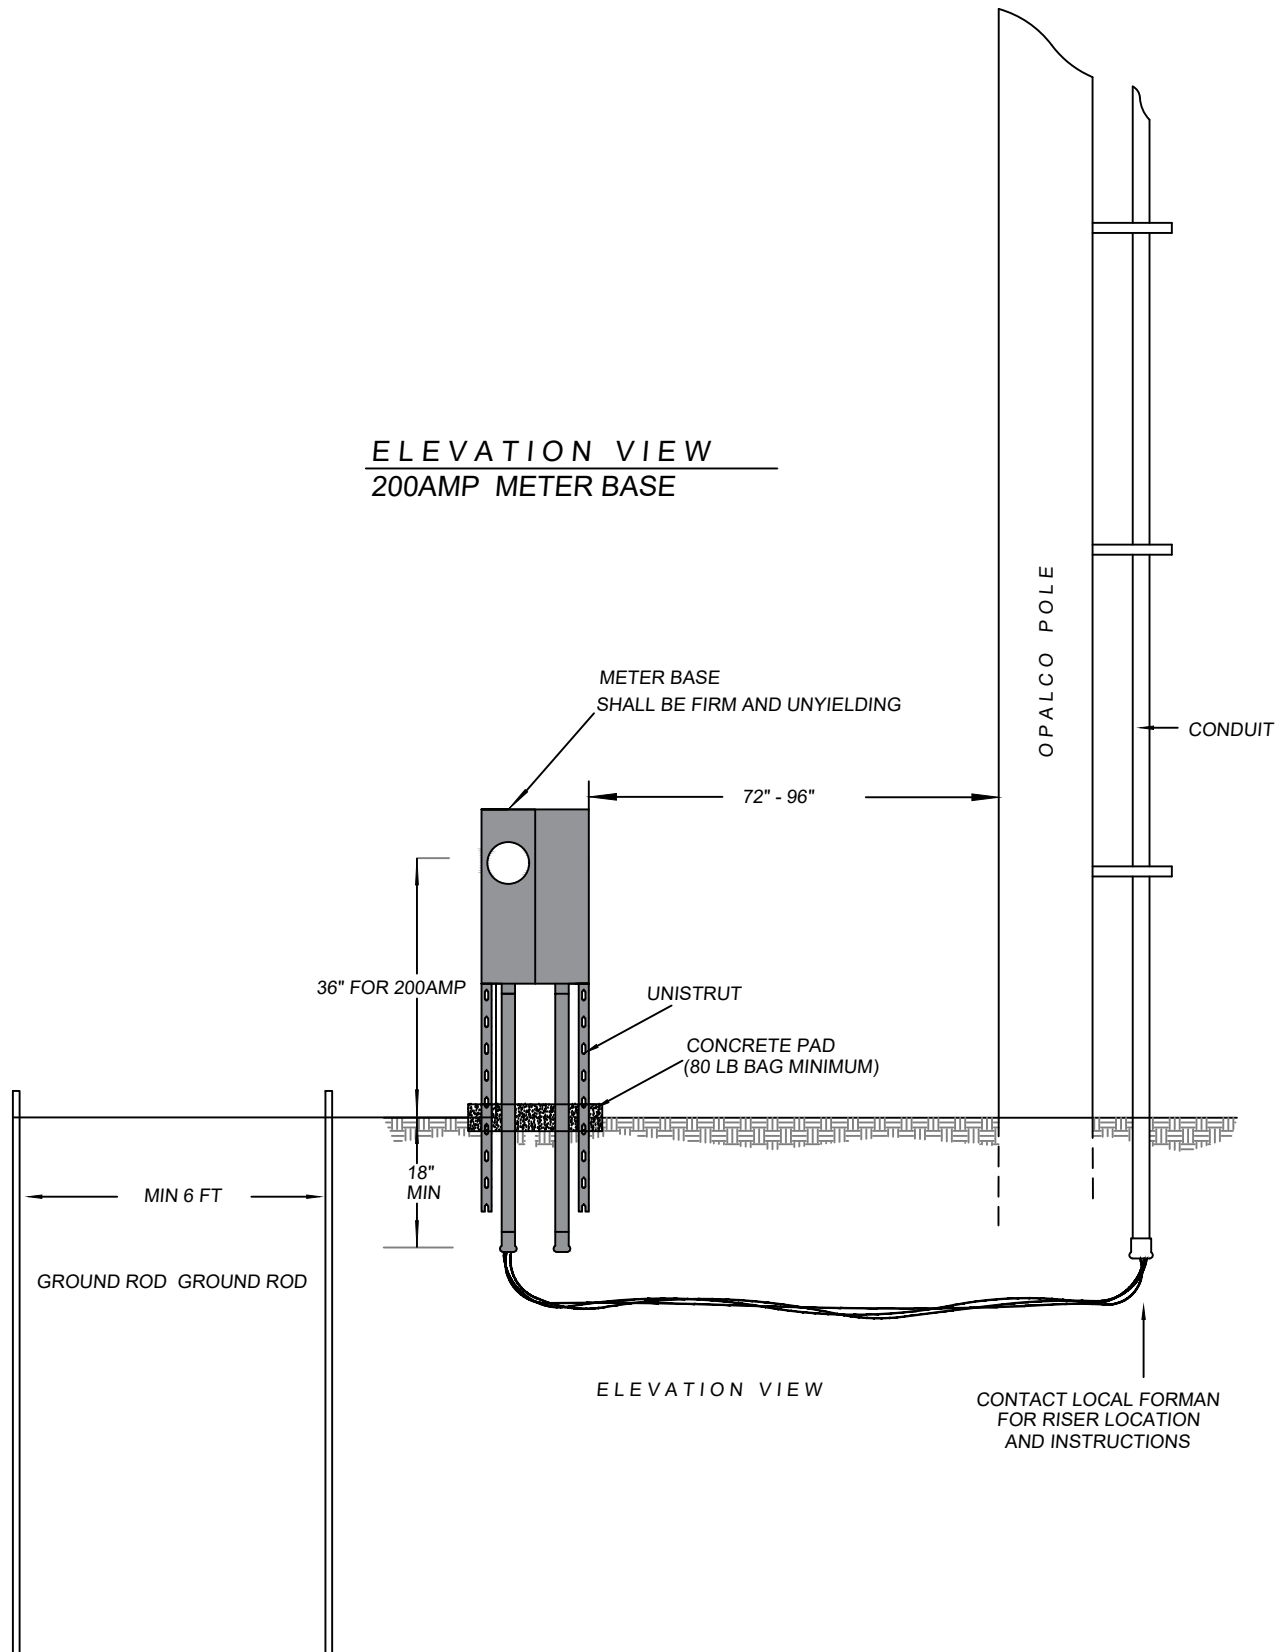

METER BASE
SHALL BE FIRM AND UNYIELDING

72" - 96"

36" FOR 200AMP

UNISTRUT

CONCRETE PAD
(80 LB BAG MINIMUM)

OPALCO POLE

CONDUIT

MIN 6 FT

GROUND ROD GROUND ROD

18"
MIN

ELEVATION VIEW

CONTACT LOCAL FORMAN
FOR RISER LOCATION
AND INSTRUCTIONS